



Notes

1. Pipe invert through the manhole shall be constructed with similar or compatible material to the connecting pipes.
 2. Concrete to conform with NZS 3104, placed and compacted to NZS 3109. No plastering allowed.
 3. No concrete shall be placed against uncompacted fill.
 4. Concrete packing level for
 - Grass - Flush with lid
 - Chipseal - Down 10mm
 - Asphalt - Down 50mm Road
 - Down 25mm Chipseal
 5. Gas tight lid or similar on Foul Sewer manhole
- 

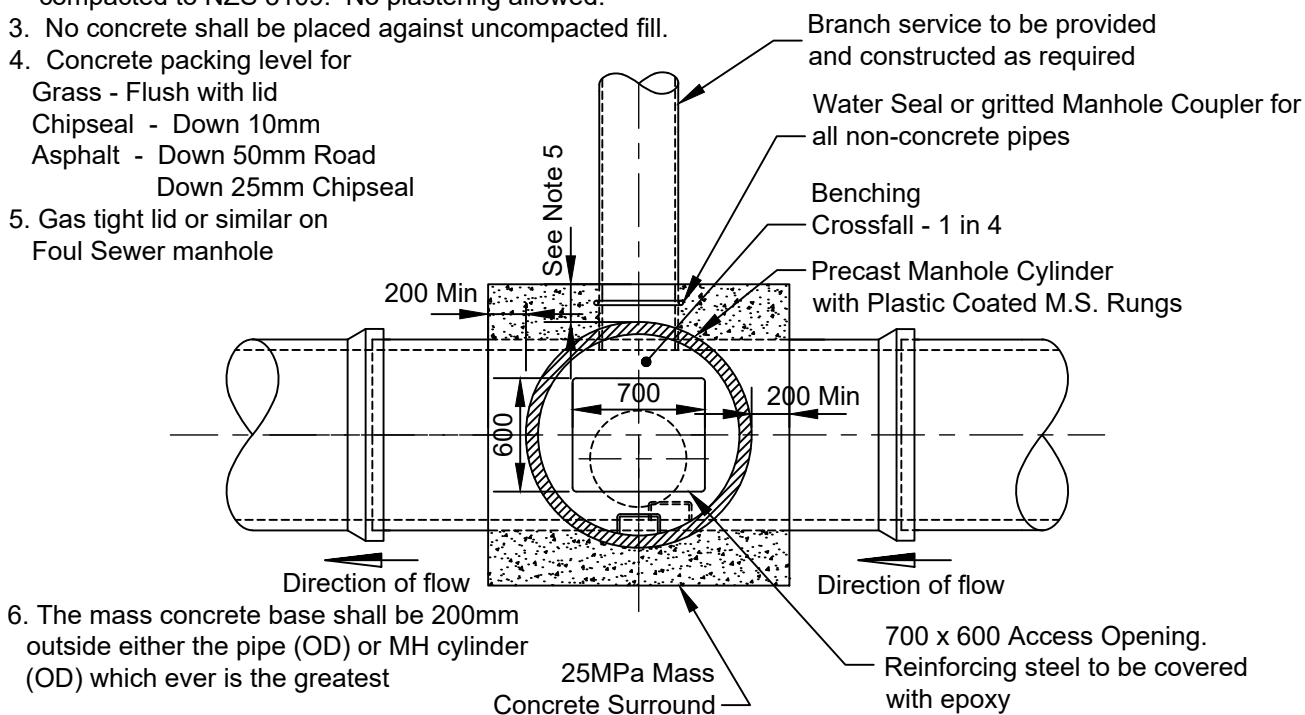

Not to scale