


#### Notes

1. Pipe invert through the manhole shall be constructed with similar or compatible material to the connecting pipes.
2. Concrete to conform with NZS 3104, placed and compacted to NZS 3109. No plastering allowed.
3. No concrete shall be placed against uncompacted fill.
4. Concrete packing level for  
 Grass - Flush with lid  
 Chipseal - Down 10mm  
 Asphalt - Down 50mm Road  
               Down 25mm Footpath
5. Gas tight lid or similar on  
 Foul Sewer manhole

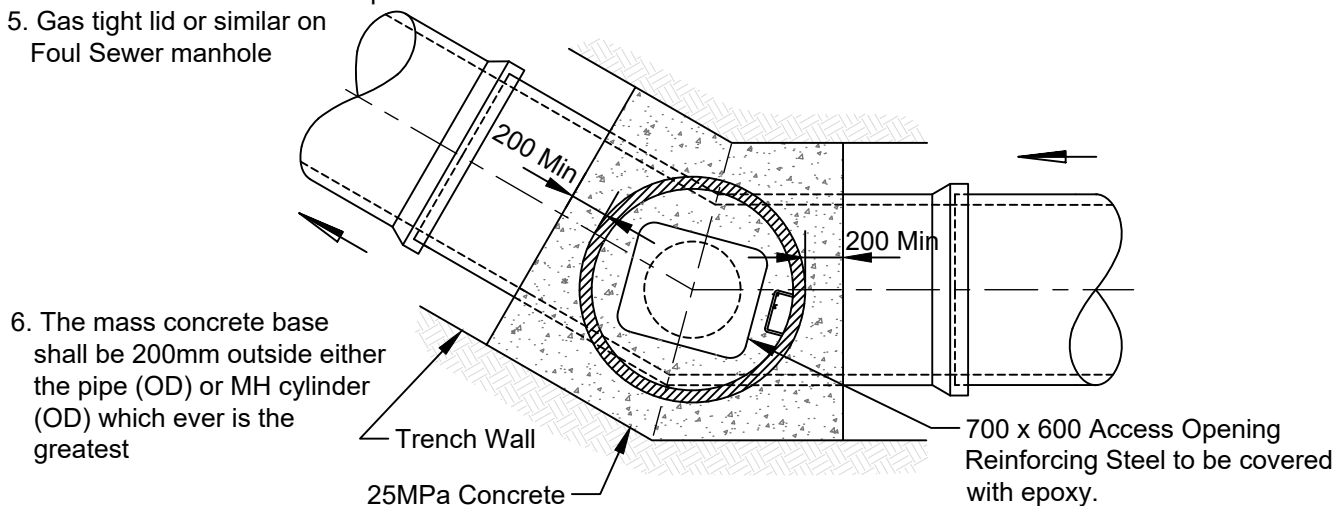

Not to scale