


SECTION 'A - A'


SECTION 'B - B'

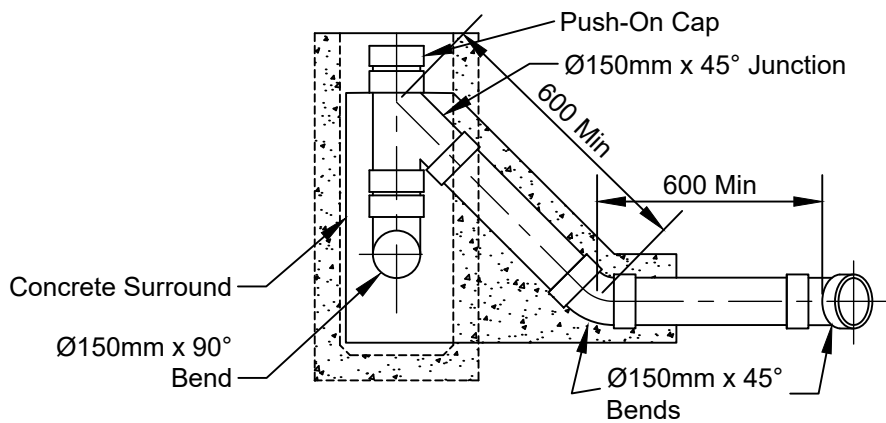

Detail of connection at back of sump

Notes.

1. Concrete to be 17.5 min MPa to NZS 3104. Compacted granular bedding and surround to AS/NZS 2566.2
2. "Back Entry" Connection shown. Connection can be fitted RH or LH as directed by Engineer.

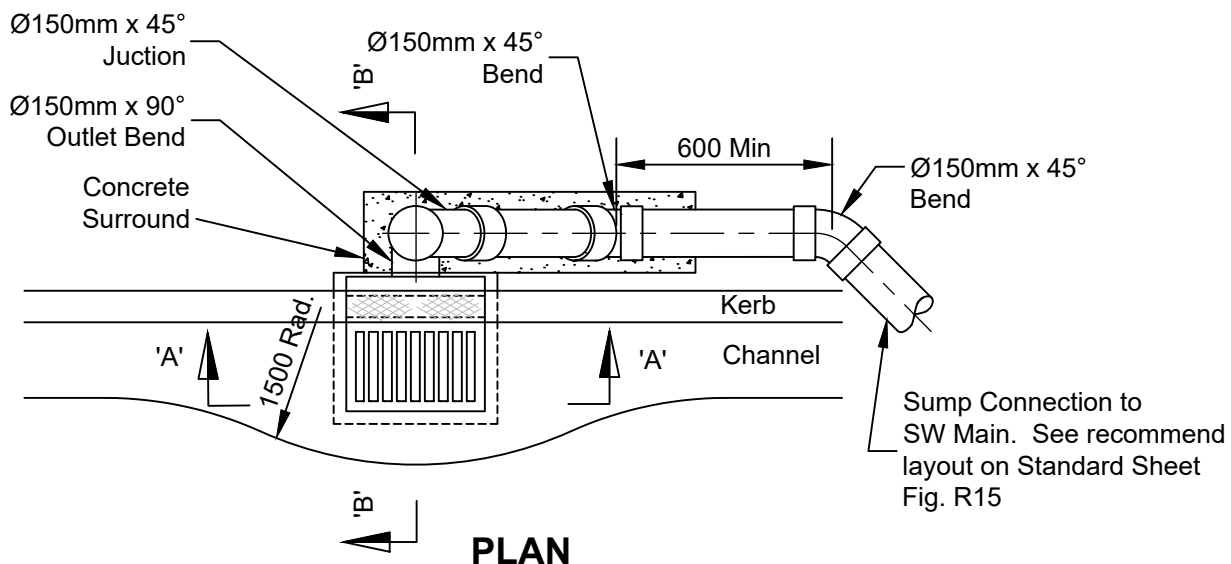

PLAN

Not to scale