


FLANGED VALVES

Notes:

1. Unsealed surfaces. Backfill to surface with specified material and ram hard.
2. Lean-mix concrete to be 10 parts aggregate to 1 part cement to be placed fairly dry and rammed hard.
3. uPVC pipe to be 250 mm dia. for 100mm dia and 200mm dia. valves and 313mm dia. for 150mm dia and 250mm dia. valves.
4. Valve to AS / NZS 2638:1999

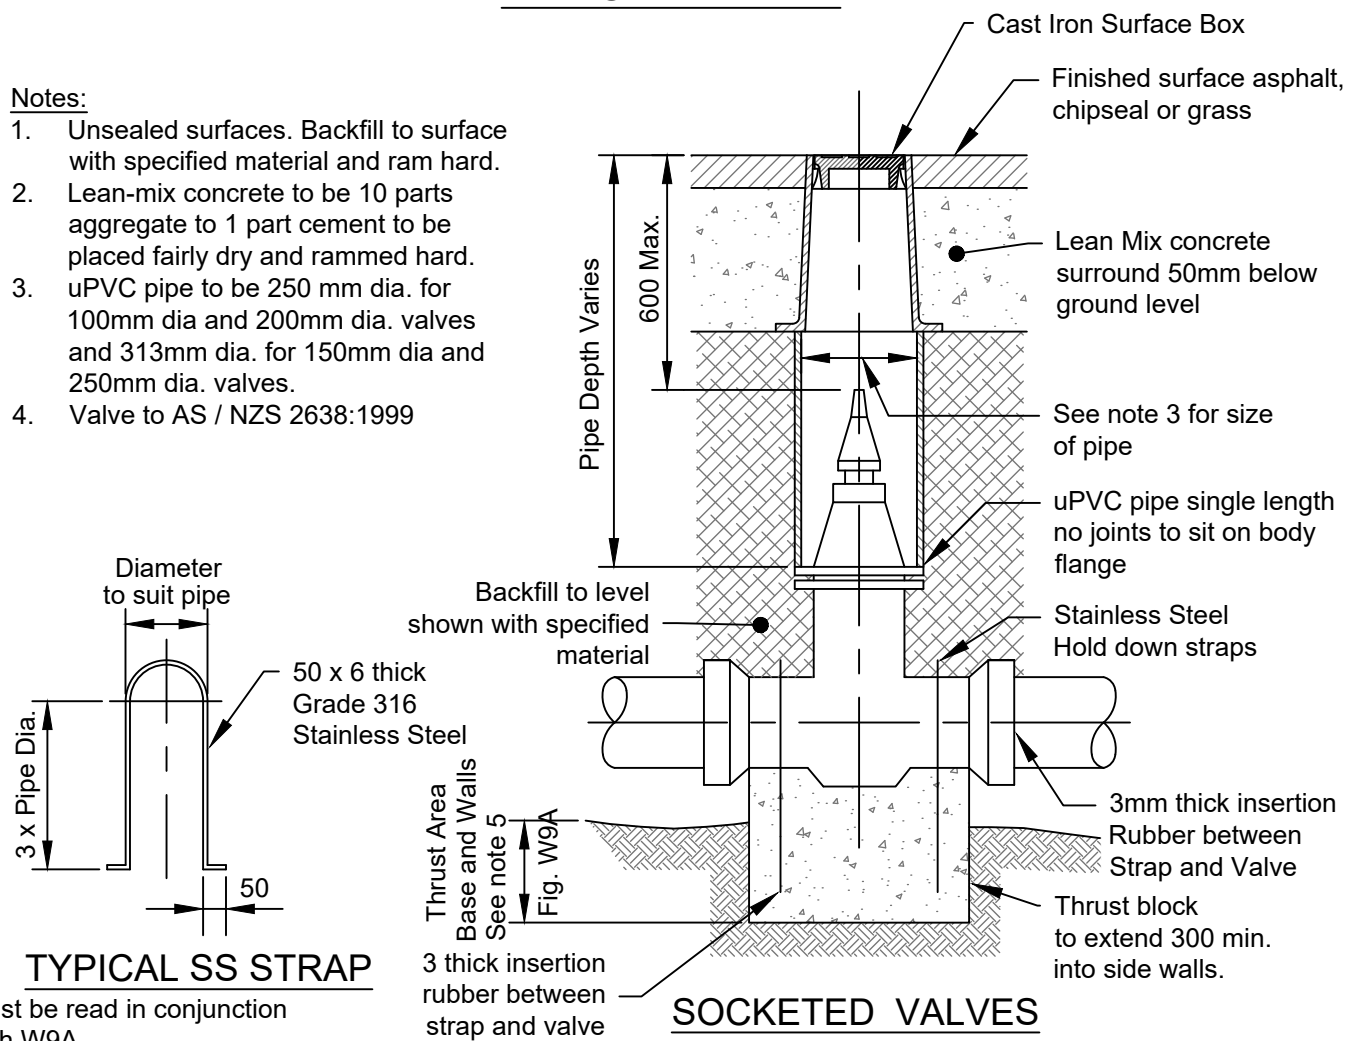

Not to scale